

1 Existing / Deconstruction Plan
E2.00 Scale 1/8"=1'-0"

SHEET NOTES:

1. REMOVE EXISTING LUMINAIRES AND PROVIDE A NEW TYPE G1, INTEGRAL OCCUPANCY SENSORS. UTILIZE EXISTING CIRCUITING AND CONNECT COMPLETE TO PANEL LA. PROVIDE ALL LABOR AND MATERIAL INCLUDING BUT NOT BE LIMITED TO CONDUIT, WIRE, SUPPORT AND JUNCTION BOXES. LUMINAIRES MAY BE USED FOR WORK LIGHTS.

GENERAL NOTES:

1. DUPLEX, DOUBLE DUPLEX AND GFCI RECEPTACLES PER SECTION 26 27 26 WILL BE 20 AMP TYPICAL IN ALL AREAS.
2. CONDUIT WILL BE EMT, MC CABLE MAY BE USED AS INSTALLED PER SPECIFICATIONS.
3. LUMINAIRES MUST BE SUPPORTED BY ADDITIONAL INDEPENDENT NO. 12 GAGE WIRES ATTACHED TO EACH CORNER OF FIXTURE.
4. SEE MECHANICAL PLANS FOR ADDITIONAL ELECTRICAL CONNECTIONS.
5. ALL CIRCUITS SHOWN ON THE ELECTRICAL PLANS MUST BE PROVIDED WITH A SEPARATE NEUTRAL FOR MULTI-BRANCH CIRCUIT REQUIREMENTS PER CURRENT CODE.
6. PROVIDE TAMPER RESISTANT RECEPTACLES IN ALL AREAS AS REQUIRED BY THE CURRENT APPROVED ADDITION OF THE NEC AND WASHINGTON AMENDMENTS
7. LIGHTING CONTROL WIRING IS SHOWN FOR REFERENCE ONLY. ELECTRICAL CONTRACTOR WILL COORDINATE EXACT WIRING METHOD WITH MANUFACTURER. PROVIDE ALL LABOR AND MATERIAL INCLUDING BUT NOT BE LIMITED TO POWER PACKS, EMERGENCY POWER PACKS, LV SWITCHES, #18 CONDUCTORS, CAT 5E CABLE, NETWORK COMPONENTS, DAYLIGHT & OCCUPANCY SENSORS AND SUPPORTS.
8. PROVIDE CAT 5E CABLE BETWEEN ALL POWER PACKS, SWITCHES AND NETWORK COMPONENTS WEATHER SPECIFICALLY SHOWN ON THE DRAWINGS OR NOT.
9. SEE LIGHTING CONTROLS DETAILS. PROVIDE ALL LABOR AND MATERIAL INDICATED IN DETAILS INCLUDING BUT NOT BE LIMITED TO LIGHT CONTROLS, JUNCTION BOXES, LV WIRING, CAT 5E CONDUCTORS AND SUPPORTS
10. ALL MOUNTING HEIGHTS FOR LUMINAIRES ARE TO BOTTOM OF FIXTURE OR AS NOTED IN LUMINAIRE SCHEDULE.
11. EXISTING FA DEVICES ARE TO BE RELOCATED TO MEET CURRENT CODES AND CONDITIONS, FIRE ALARM INSTALLATION IS DESIGN BUILD

DEMOLITION SCOPE OF WORK:

SCOPE: THE SCOPE OF WORK INCLUDES THE REMODEL OF THE EXISTING BUILDING. THE WORK WILL INCLUDE BUT NOT BE LIMITED TO DEMOLITION (SEE BELOW) OF THE LIGHTING POWER, AND TELECOMMUNICATION DEVICES INCLUDING BUT NOT BE LIMITED TO CONDUIT, CONDUCTORS, JUNCTION BOXES AND SUPPORTS. THE DEMO OF MECHANICAL EQUIPMENT AND EQUIPMENT PROVIDED BY OTHERS, THE ELECTRICAL CONTRACTOR WILL DISCONNECT THE EQUIPMENT.

DEMOLITION: ELECTRICAL DRAWINGS ARE DIAGRAMMATIC. DEMOLITION INFORMATION HAS BEEN LISTED ON THE CONSTRUCTION DRAWINGS, IN THE SPECIFICATIONS OR INDICATED BELOW. ELECTRICAL DEVICES AND EQUIPMENT ARE FROM PICTURES, EXISTING RECORD DRAWINGS AND / OR SITE OBSERVATIONS. THEIR ACCURACY IS NOT GUARANTEED. IT WILL BE THE ELECTRICAL CONTRACTORS RESPONSIBILITY TO VISIT THE SITE PRIOR TO BID AND VERIFY ALL EXISTING CONDITIONS AND INCLUDE ALL LABOR AND MATERIAL REQUIRED FOR THE WORK INDICATED IN THE CONSTRUCTION SET

THE PURPOSE OF THE DEMOLITION INFORMATION IS TO OUTLINE A GENERAL DIRECTION OF WHAT NEEDS TO BE REMOVED TO ACCOMPLISH THE RENOVATION WORK. THE WORK IS DIAGRAMMATIC IN NATURE AND IS NOT INTENDED TO BE ALL INCLUSIVE. THE CONTRACTOR IS RESPONSIBLE TO VERIFY EXISTING CONDITIONS AT THE SITE AND INCLUDE ALL WORK EVIDENT BY SITE INSPECTION WHETHER OR NOT SHOWN ON THE DRAWINGS, TO ACHIEVE THE DESIRED RESULTS INDICATED ON THE DOCUMENTS FOR THE FINISHED SPACES.

INTERIOR LIGHTING - EXISTING INTERIOR LUMINAIRES AND ASSOCIATED CIRCUITING WILL BE REMOVED UNLESS NOTED OTHERWISE ON DRAWINGS. REMOVE EXISTING LUMINAIRES AND ASSOCIATED BRANCH CIRCUITING INCLUDING BUT NOT BE LIMITED TO LUMINAIRE, CONDUIT, WIRE, SWITCHES AND SUPPORTS. CONTRACTOR TO FIELD VERIFY.


POWER AND TELECOM - EXISTING POWER AND TELECOMMUNICATIONS DEVICES WILL BE REMOVED UNLESS NOTED OTHERWISE ON DRAWINGS. REMOVE DEVICES AND ASSOCIATED CIRCUITING INCLUDING BUT NOT BE LIMITED TO CONDUIT, CONDUCTORS, AND SUPPORTS. TELECOM WILL BE REMOVED BACK TO PATCH PANELS. CONTRACTOR TO FIELD VERIFY.

DISTRIBUTION - EXISTING PANELS WILL BE REMOVED UNLESS NOTED OTHERWISE ON DRAWINGS. REMOVE DEVICES AND ASSOCIATED FEEDERS AND BRANCH CIRCUITING INCLUDING BUT NOT BE LIMITED TO CONDUIT, CONDUCTORS, AND SUPPORTS. TELECOM WILL BE REMOVED BACK TO PATCH PANELS. CONTRACTOR TO FIELD VERIFY.

FIRE ALARM SYSTEM - EXISTING FA DEVICES ARE TO BE RELOCATED TO MEET CURRENT CODES AND CONDITIONS, FIRE ALARM IS DESIGN BUILD, PROVIDE ADDITIONAL DEVICES AS REQUIRED FOR NEW CONDITIONS

REVISED

4:13 pm, Oct 06, 2023

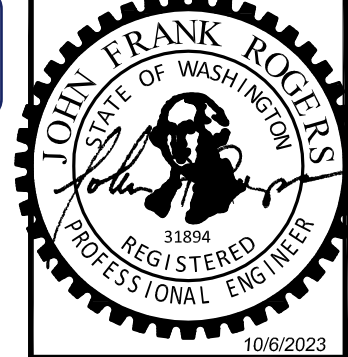

LEEKA Architecture and Planning
Creating Positive Impressions in the Built Environment

503.444.4222
succeed@leeka.com
www.leeka.com

1001 SE Water Avenue Suite 175
Portland, Oregon 97214

Tenant Improvement
ESD112
Mental Health Facility Phase II
2400 NE 68th Ave. Vancouver WA.

Revised:	DATE: AUG. 10, 2023	DATE: AUG. 17, 2023	DATE: SEPT. 22, 2023	DATE: OCT. 03, 2023
PCR 01	APPLICANT EDITS	APPLICANT EDITS	APPLICANT EDITS	APPLICANT EDITS

Job No: 2246

Date: February 18, 2023

File Size: 24x36

Progress set

DRAWN:

CHECKED:

Sheet Title

Deconstruction Plan

Sheet Number

E2.00

SYSTEM
DESIGN
CONSULTANTS INC.
333 SE SECOND AVE, SUITE 100
PORTLAND, OREGON 97214
503-248-0227
CONTACT: JEFFREY DAVIS